AFZ PROJECT:

BUSHFIRE CONTROL - WARRIOR FZ MOTORISED SHUTTER TEMPLATE

ATTENTION: TECHNICAL REQUIREMENTS FOR THIS PROJECT

No	DESCRIPTION	REQUIREMENT	RESPONSIBILITY
1	WORKS DONE BY OTHERS	ALL DETAILS PERTAINING TO WORK BY OTHERS IS AN ADVISEMENT ONLY AND IT IS THE RESPONSIBILITY OF THE SUPPLIER AND INSTALLER OF THE ITEM/S TO CONFIRM COMPLIANCE TO ITS SUITABILITY FOR THE PURPOSE AND TO CERTIFY ITS COMPLIANCE TO THE REQUIRED FRL TO THE SATISFACTION OF THE FE OR CERTIFIER.	BUILDER, ARCHITECT, OTHER TRADES
2	SHOP DRAWINGS	APPROVAL OF SHOP DRAWINGS (SIGNITURE AND DATE) IS REQUIRED TO BE RETURNED TO BUSHFIRE CONTROL BEFORE MANUFACTURE CAN COMMENCE.	BUILDER, ARCHITECT
3	DELIVERIES TO SITE	IF REQD, FORKLIFT TO BE MADE AVAILABLE.	BUILDER
4	VERTICAL MOVEMENT OF PRODUCT	IF REQD, CRANE SHALL BE AVAILABLE TO BUSHFIRE CONTROL AT AGREED TIME OF DELIVERY. IF THIS IS NOT AVAILABLE, THIS MAY INCUR EXTRA CHARGES.	BUILDER
5	STORAGE	SUFFICIENT CLEAR FLOOR SPACE TO BE MADE AVAILABLE IMMEDIATELY ADJACENT TO EACH INSTALLATION LOCATION.	BUILDER
6	ACCESS TO WORKFACE (INSTALLATION)	ADEQUATE WORKING AREA REQD., MIN 500mm FROM SYSTEM TO STRUCTURE IS IDEAL. SUBJECT TO SITE CONDITIONS.	BUILDER
7	POSSIBLE OBSTRUCTIONS (WHERE PRESENT)	THERE MUST NOT BE ANYTHING INTERFERING WITH THE OPERATION OF SHUTTER IN ANY WAY. MIN. 100mm FROM SYSTEM TO ANY POSSIBLE OBSTRUCTION TO DROP LINE OF BOTTOM BAR IS IDEAL.	BUILDER
8	ACCESS PANELS (INSTALATION WITHIN CEILING CAVITY)	450X450 NOM. ACCESS PANELS TO BE PROVIDED AT THE NOMINATED LOCATION OF SHUTTER CONTROLLER. MAY NOT BE REQD. WHERE REMOVABLE GRID CEILING ALLOWS FOR CLEAR ACCESS TO SHUTTER CONTROLLERS.	BUILDER, CEILING CONTRACTOR
9	POWER REQUIREMENTS	FOR ALL MOTORISED SHUTTERS, A 240 VOLT 10 AMP GPO TO BE LOCATED WITHIN 1 METRE OF SHUTTER HEAD BOX ON MOTOR SIDE. RUNNING OF POWER CABLE THROUGH WALL AND ALL ASSOCIATED FLASHING/WATERPROOFING BY OTHERS.	BUILDER, ELECTRICAL
10	ACTIVATION	MOTORISED SHUTTER ARE ACTIVATED MANUALLY VIA A CONTROL SWITCH. CONTROL SWITCH TO BE LOCATED ON INTERNAL AND EXTERNAL FACE OF WALL ADJACENT TO SHUTTER SYSTEM. RUNNING OF CABLES THROUGH WALL AND ALL ASSOCIATED FLASHING/WATERPROOFING BY OTHERS. WINDOWSHIELD ARE MANUALLY RELEASED BY HAND BY UNTIEING CABLE.	BUSHFIRE CONTROL, BUILDER
11	CERTIFICATON	WITNESS TESTING, FINAL COMMISSIONING & HANDOVER	BUSHFIRE CONTROL

Sheet List Table

SHEET NUMBER	SHEET DESCRIPTION	REV
00 - SPECIFICATIONS		
0001	COVER SHEET	A
02 - WARRIOR FZ MOTORISED SHUTTERS		
0201	FRONT ELEVATION	A
0202	CLOSEUP DETAIL	A
0203	TYPICAL WIRE CONFIGURATION - 1	B
0204	TYPICAL WIRE CONFIGURATION - 2	A
0205	TYPICAL WIRE CONFIGURATION - 3	A

SYSTEM	COMPONENT	MATERIALS	FRL	COLOUR/FINISH		
WARRIOR FZ MOTORISED SHUTTER	HEAD BOX & BOTTOM BAR	GALVANISED STEEL	BAL FZ AS1530.8.2	HEAD BOX		POWDER COATING TO DULUX DURALLOY COLOURS IS INCLUDED. OTHER NON-STANDARD COLOURS OR GRADES WILL INCUR AN EXTRA CHARGE UNLESS STATED OR AGREED UPON OTHERWISE WILL COME IN RAW GALVANISED FINISH IF COLOUR IS NOT PROVIDED BY CLIENT
	SIDE GUIDES	GALVANISED STEEL		SIDE GUIDES		
	FABRIC	1100°C RATED		BOTTOM BAR		

PRODUCT SPECIFICATIONS

- THIS DRAWING IS COPYRIGHT AND THE PROPERTY OF THE AUTHOR, AND MUST NOT BE RETAINED, COPIED OR USED WITHOUT THE AUTHORITY OF BUSHFIRE CONTROL PTY. LTD.
- DO NOT SCALE FROM DRAWING, USE PROVIDED DIMENSIONS ONLY.
- ALL DISCREPENCIES MUST BE BROUGHT TO THE ATTENTION OF AUTHOR.
- SMOKE CONTROL SYSTEMS DO NOT TAKE RESPONSIBILITY OF MEASUREMENTS PROVIDED BY OTHERS.

REV	CHK	REASON	DATE
A	AC	RELEASED	27/08/2020

DISCLAIMER

INFORMATION GIVEN IN WARRIORWINDOWS.COM.AU AND PUBLICATIONS FOR DOWNLOAD ARE GIVEN TO THE BEST OF OUR KNOWLEDGE AND IN GOOD FAITH. BUSHFIRE CONTROL IS NOT RESPONSIBLE IF RECIPIENTS OF TEST REPORTS, ASSESSMENTS OR LITERATURE MISINTERPRET THE CONTENTS AND WRONGLY USE PRODUCTS BASED ON THOSE MISINTERPRETATIONS. NO LIABILITY IS ACCEPTED FOR ERROR OMISSIONS IN THIS WEB SITE OR OUR DOCUMENTS. IN THE INTERESTS OF IMPROVEMENTS AND CONTINUED DEVELOPMENT BUSHFIRE CONTROL RESERVES THE RIGHT TO CHANGE SPECIFICATION WITHOUT NOTICE.

INFORMATION COPY ONLY

BUSHFIRE CONTROL | WARRIOR

WWW.BUSHFIRECONTROL.COM.AU

ABN 92 623 863 810
20 GEORGE YOUNG STREET
AUBURN, NSW 2144

EMAIL: INFO@BUSHFIRECONTROL.COM.AU
FREE CALL: 1800 218 258
FAX: (02) 9681 1600

PROJECT
SCS/BC - WS TEMP
BUSHFIRE CONTROL - WARRIOR FZ MOTORISED SHUTTER TEMPLATE

CLIENT

TITLE
COVER SHEET

SUB SET (CATEGORY)
00 - SPECIFICATIONS

DRAWING NUMBER
SCS/BC - WS TEMP-0001

REV
A

DRAWN BY
ISHTIAQUE ALAM

ISSUE STATUS:
INFORMATION ONLY

START DATE
20/07/2020

SCALE
AS SHOWN @A2


FILE: Bushfire Control - Warrior FZ Shutter.dwg --- PLOTTED ON 30/06/2022 BY OZRA KHADEMI


420mm >>>

<<< 594mm

NOTES:

1. WINDOW/DOOR SIZES ARE NOMINAL
2. MAXIMUM WINDOW/DOOR OPENING IS 2.7m WIDE x 2.5m HIGH. ANY WINDOWS/DOORS ABOVE THESE DIMENSIONS WILL BE REQUIRED TO BE WARRIOR FZ MOTORISED SHUTTER.
3. AWNING TYPE WINDOWS AND DOORS MUST OPEN AWAY FROM WARRIOR SYSTEM.
4. SYSTEM WEIGHT 25kgs PER METER.

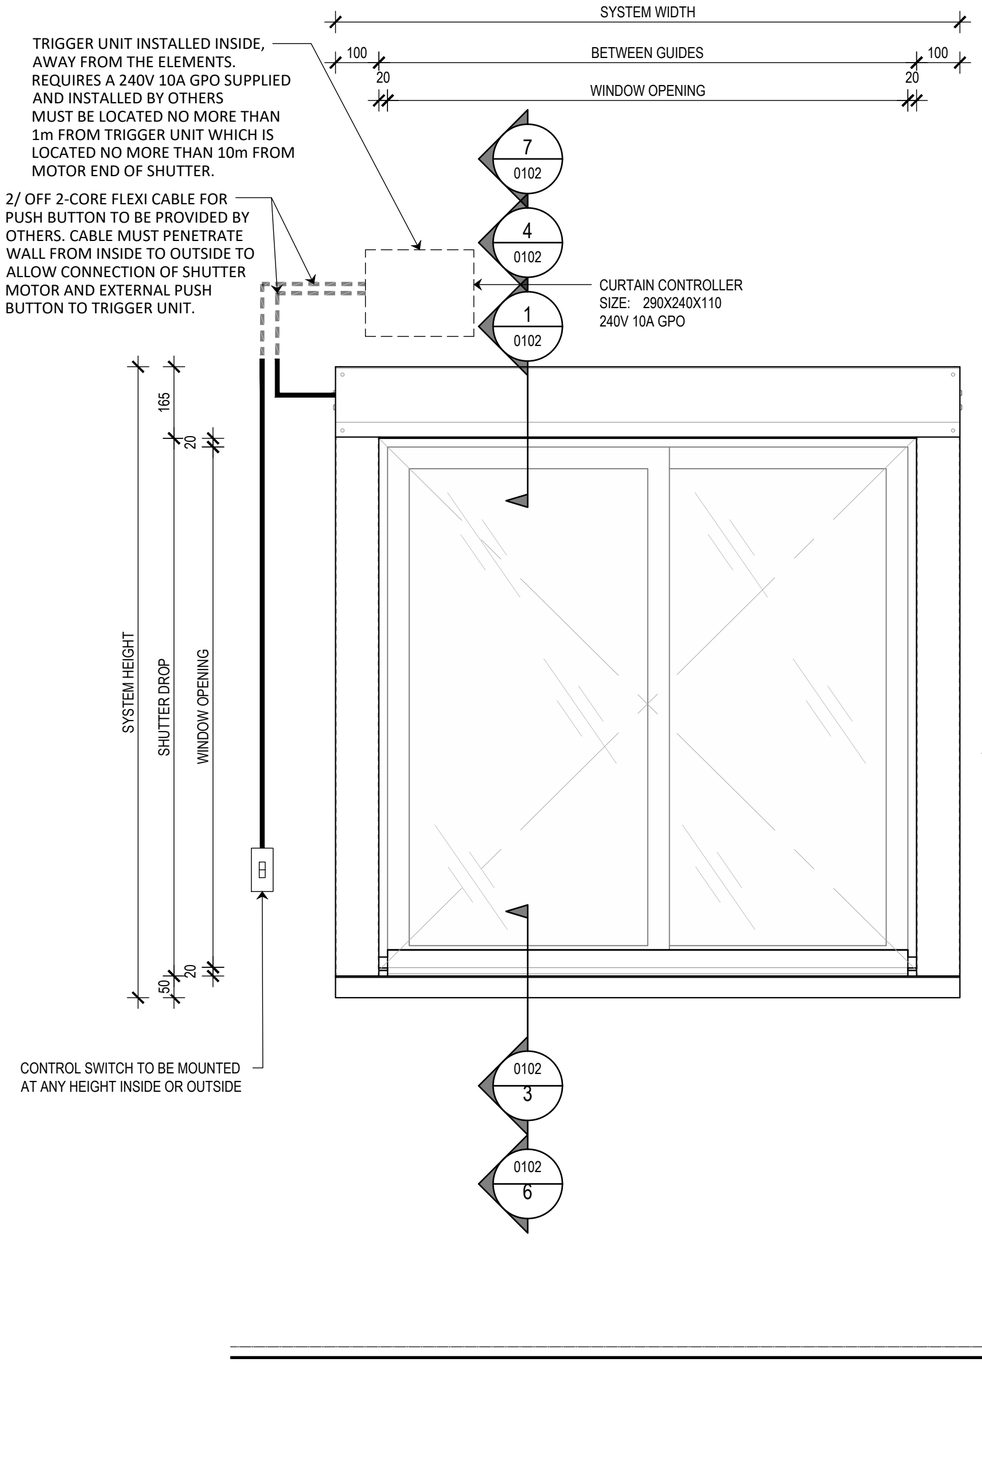

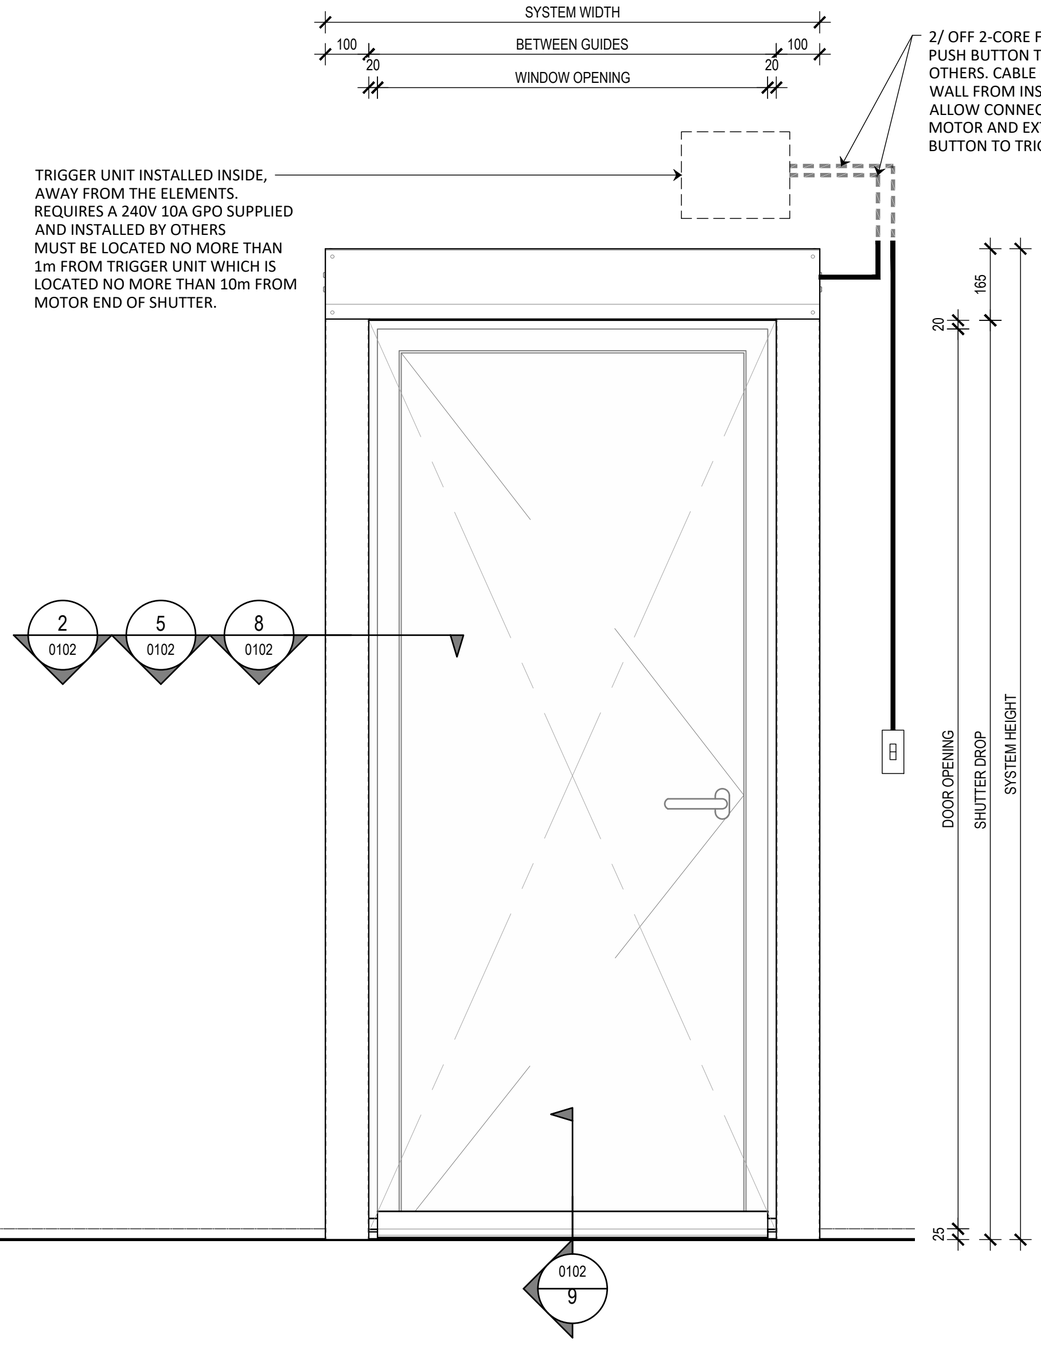

1 FRONT ELEVATION - VIEW FROM OUTSIDE
WARRIOR FZ MOTORISED SHUTTER OVER WINDOW
SCALE 1:10 @ A2

2 FRONT ELEVATION - VIEW FROM OUTSIDE
WARRIOR FZ MOTORISED SHUTTER OVER DOOR
SCALE 1:10 @ A2

- THIS DRAWING IS COPYRIGHT AND THE PROPERTY OF THE AUTHOR, AND MUST NOT BE RETAINED, COPIED OR USED WITHOUT THE AUTHORITY OF BUSHFIRE CONTROL PTY. LTD.
- DO NOT SCALE FROM DRAWING, USE PROVIDED DIMENSIONS ONLY.
- ALL DISCREPENCIES MUST BE BROUGHT TO THE ATTENTION OF AUTHOR.
- SMOKE CONTROL SYSTEMS DO NOT TAKE RESPONSIBILITY OF MEASUREMENTS PROVIDED BY OTHERS.

REV	CHK	REASON	DATE
A	AC	RELEASED	27/08/2020

DISCLAIMER

INFORMATION GIVEN IN WARRIORWINDOWS.COM.AU AND PUBLICATIONS FOR DOWNLOAD ARE GIVEN TO THE BEST OF OUR KNOWLEDGE AND IN GOOD FAITH. BUSHFIRE CONTROL IS NOT RESPONSIBLE IF RECIPIENTS OF TEST REPORTS, ASSESSMENTS OR LITERATURE MISINTERPRET THE CONTENTS AND WRONGLY USE PRODUCTS BASED ON THOSE MISINTERPRETATIONS. NO LIABILITY IS ACCEPTED FOR ERROR OMISSIONS IN THIS WEB SITE OR OUR DOCUMENTS. IN THE INTERESTS OF IMPROVEMENTS AND CONTINUED DEVELOPMENT BUSHFIRE CONTROL RESERVES THE RIGHT TO CHANGE SPECIFICATION WITHOUT NOTICE.

INFORMATION COPY ONLY

BUSHFIRE CONTROL | WARRIOR

WWW.BUSHFIRECONTROL.COM.AU

ABN 92 623 863 810
20 GEORGE YOUNG STREET
AUBURN, NSW 2144

EMAIL: INFO@BUSHFIRECONTROL.COM.AU
FREE CALL: 1800 218 258
FAX: (02) 9681 1600

PROJECT
SCS/BC - WS TEMP
BUSHFIRE CONTROL - WARRIOR FZ
MOTORISED SHUTTER TEMPLATE

CLIENT

TITLE
FRONT ELEVATION


SUB SET (CATEGORY)
02 - WARRIOR FZ MOTORISED SHUTTERS

DRAWING NUMBER	REV
SCS/BC - WS TEMP-0201	A


DRAWN BY	ISSUE STATUS:
ISHTIAQUE ALAM	INFORMATION ONLY
START DATE: 20/07/2020	SCALE: AS SHOWN @A2

FILE: Bushfire Control - Warrior FZ Shutter.dwg --- PLOTTED ON 30/06/2022 BY OZRA KHADEMI


<<< 420mm
<<< 594mm

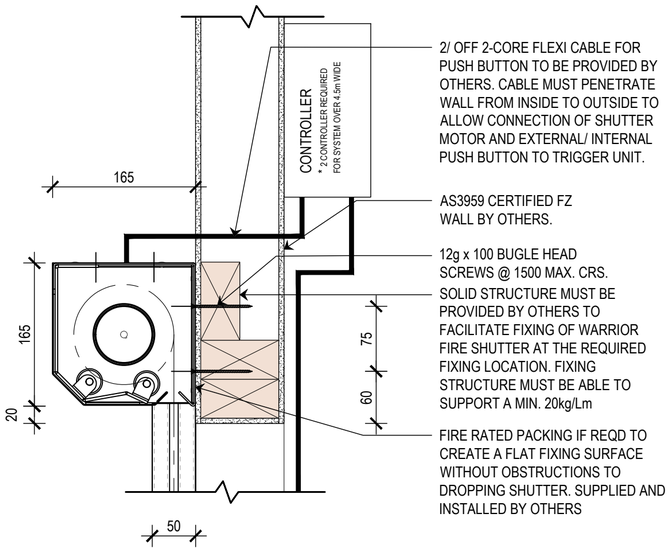

TYPICAL HEADBOX DETAIL
1 STUD WALL STRUCTURE
SCALE 1:10 @ A2

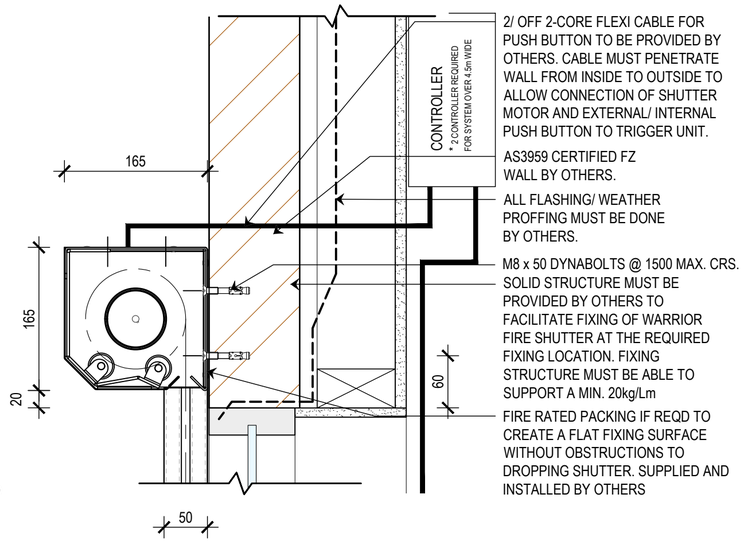

TYPICAL HEADBOX DETAIL
4 MASONRY WALL STRUCTURE
SCALE 1:10 @ A2

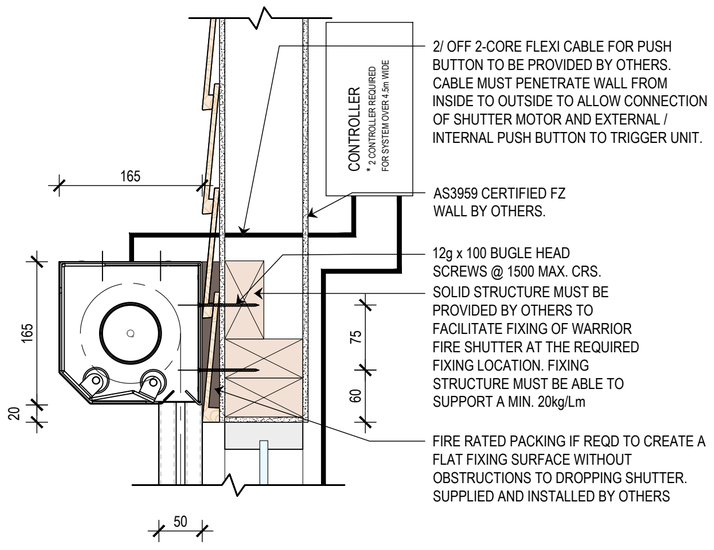


TYPICAL HEADBOX DETAIL
7 WEATHERBOARD WALL STRUCTURE
SCALE 1:10 @ A2


TYPICAL SIDE GUIDE DETAIL
2 STUD WALL STRUCTURE
SCALE 1:10 @ A2

TYPICAL SIDE GUIDE DETAIL
5 MASONRY WALL STRUCTURE
SCALE 1:10 @ A2


TYPICAL SIDE GUIDE DETAIL
8 WEATHERBOARD WALL STRUCTURE
SCALE 1:10 @ A2

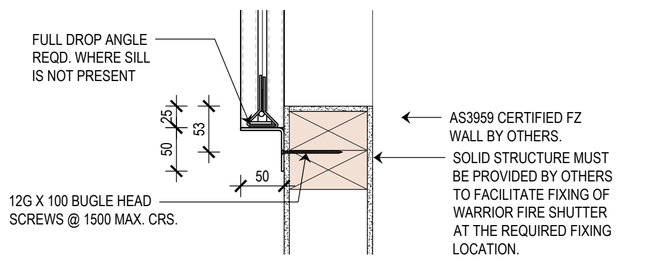

TYPICAL WINDOW SILL DETAIL
3 STUD/W.B WALL STRUCTURE
SCALE 1:10 @ A2

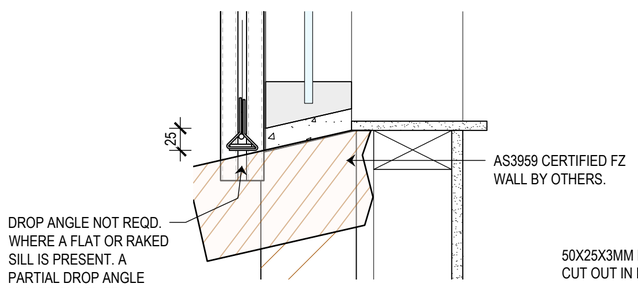

TYPICAL WINDOW RAKE SILL DETAIL
6 MASONRY WALL STRUCTURE
SCALE 1:10 @ A2

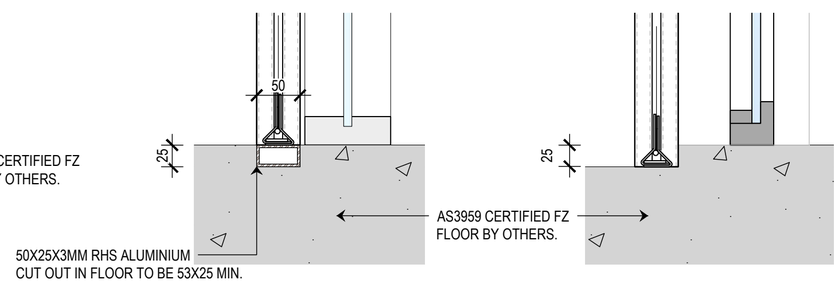

TYPICAL DOOR SILL DETAIL
9 MASONRY FLOOR STRUCTURE
SCALE 1:10 @ A2

- THIS DRAWING IS COPYRIGHT AND THE PROPERTY OF THE AUTHOR, AND MUST NOT BE RETAINED, COPIED OR USED WITHOUT THE AUTHORITY OF BUSHFIRE CONTROL PTY. LTD.
- DO NOT SCALE FROM DRAWING, USE PROVIDED DIMENSIONS ONLY.
- ALL DISCREPENCIES MUST BE BROUGHT TO THE ATTENTION OF AUTHOR.
- SMOKE CONTROL SYSTEMS DO NOT TAKE RESPONSIBILITY OF MEASUREMENTS PROVIDED BY OTHERS.

REV	CHK	REASON	DATE
A	AC	RELEASED	27/08/2020

DISCLAIMER

INFORMATION GIVEN IN WARRIORWINDOWS.COM.AU AND PUBLICATIONS FOR DOWNLOAD ARE GIVEN TO THE BEST OF OUR KNOWLEDGE AND IN GOOD FAITH. BUSHFIRE CONTROL IS NOT RESPONSIBLE IF RECIPIENTS OF TEST REPORTS, ASSESSMENTS OR LITERATURE MISINTERPRET THE CONTENTS AND WRONGLY USE PRODUCTS BASED ON THOSE MISINTERPRETATIONS. NO LIABILITY IS ACCEPTED FOR ERROR OMISSIONS IN THIS WEB SITE OR OUR DOCUMENTS. IN THE INTERESTS OF IMPROVEMENTS AND CONTINUED DEVELOPMENT BUSHFIRE CONTROL RESERVES THE RIGHT TO CHANGE SPECIFICATION WITHOUT NOTICE.

INFORMATION COPY ONLY

BUSHFIRE CONTROL
WARRIOR

WWW.BUSHFIRECONTROL.COM.AU

ABN 92 623 863 810
20 GEORGE YOUNG STREET
AUBURN, NSW 2144

EMAIL: INFO@BUSHFIRECONTROL.COM.AU
FREE CALL: 1800 218 258
FAX: (02) 9681 1600

PROJECT
SCS/BC - WS TEMP
BUSHFIRE CONTROL - WARRIOR FZ
MOTORISED SHUTTER TEMPLATE

CLIENT

TITLE
CLOSEUP DETAIL


SUB SET (CATEGORY)
02 - WARRIOR FZ MOTORISED SHUTTERS

DRAWING NUMBER	REV
SCS/BC - WS TEMP-0202	A

DRAWN BY	ISSUE STATUS:
ISHTIAQUE ALAM	INFORMATION ONLY
START DATE	SCALE
20/07/2020	AS SHOWN @A2

<<< 420mm
<<< 594mm

FILE: Bushfire Control - Warrior FZ Shutter.dwg --- PLOTTED ON 30/06/2022 BY OZRA KHADEMI

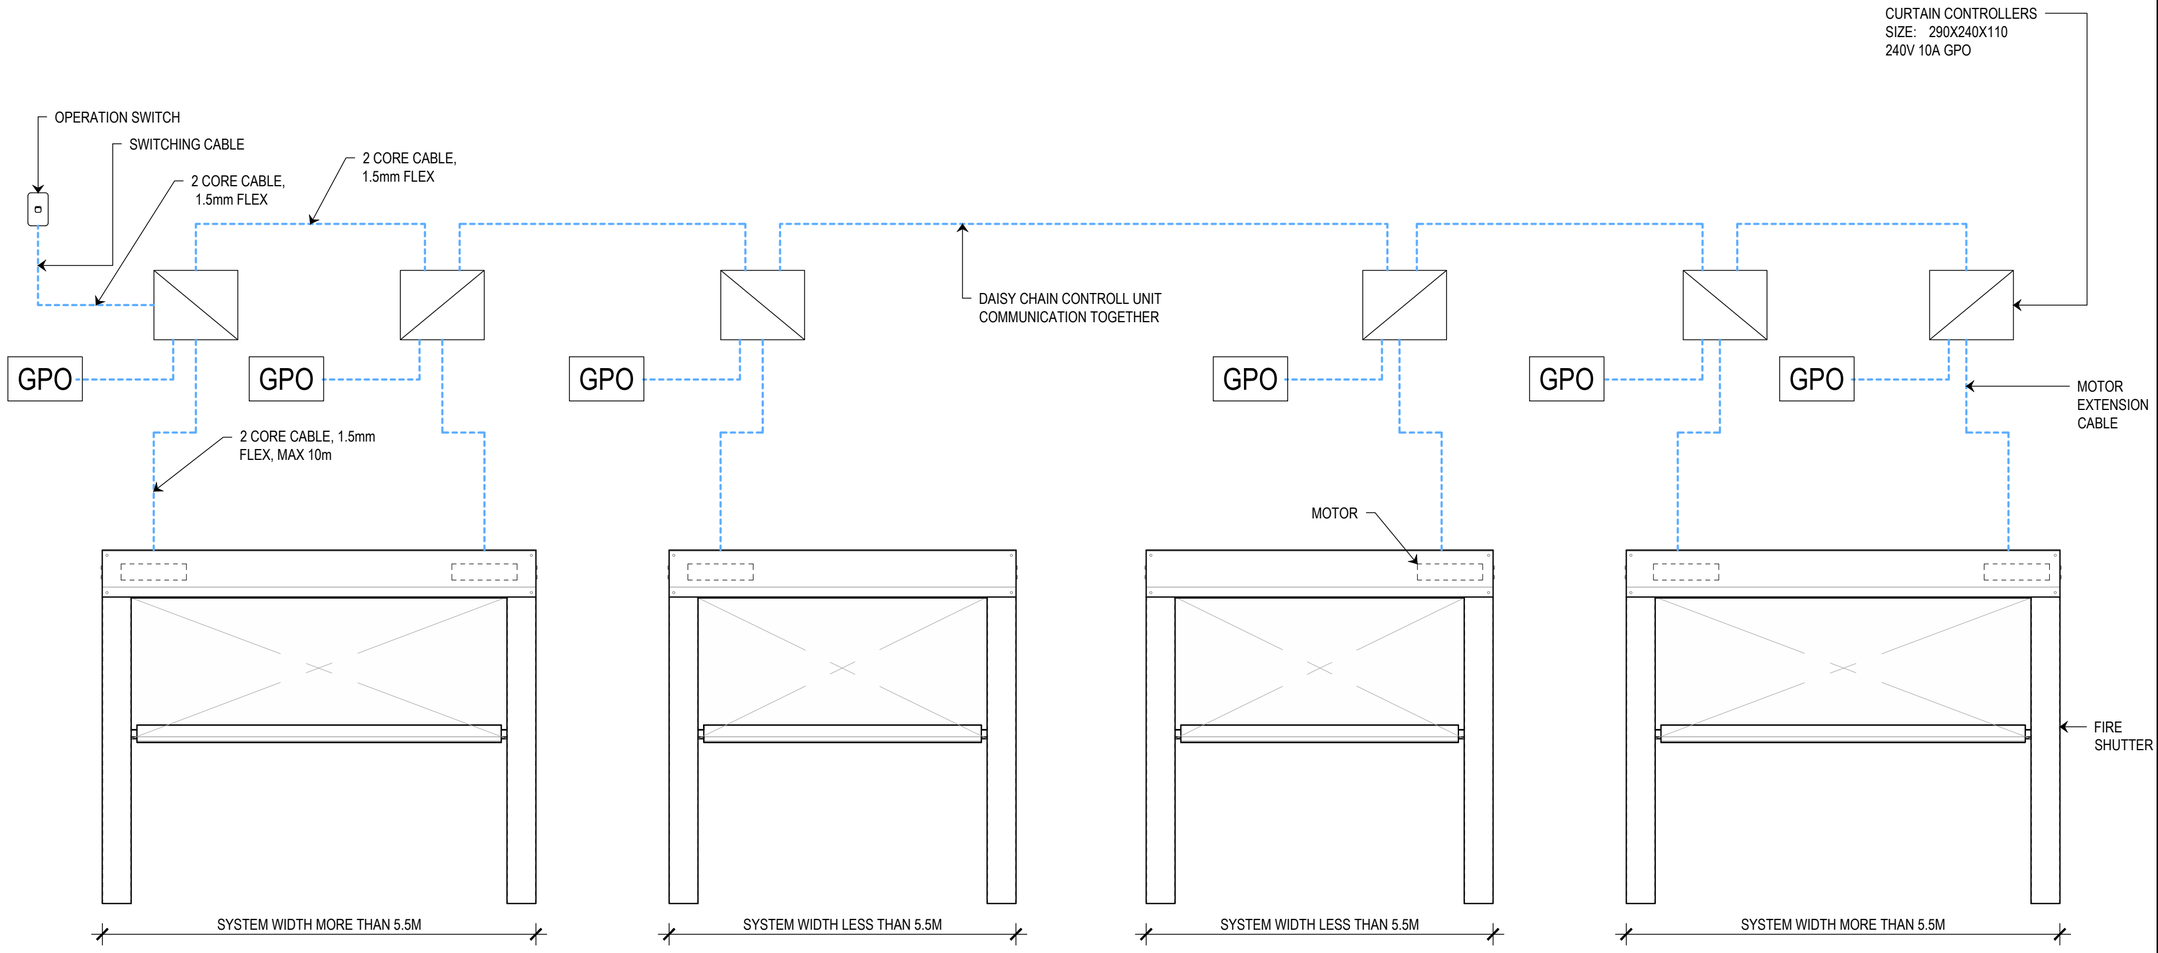

1 TYPICAL WIRE CONFIGURATION (INDICATIVE ONLY)

- THIS DRAWING IS COPYRIGHT AND THE PROPERTY OF THE AUTHOR, AND MUST NOT BE RETAINED, COPIED OR USED WITHOUT THE AUTHORITY OF BUSHFIRE CONTROL PTY. LTD.
- DO NOT SCALE FROM DRAWING, USE PROVIDED DIMENSIONS ONLY.
- ALL DISCREPENCIES MUST BE BROUGHT TO THE ATTENTION OF AUTHOR.
- SMOKE CONTROL SYSTEMS DO NOT TAKE RESPONSIBILITY OF MEASUREMENTS PROVIDED BY OTHERS.

REV	CHK	REASON	DATE
A	AC	RELEASED	27/08/2020
B	AC	RELEASED	19/10/2020

DISCLAIMER

INFORMATION GIVEN IN WARRIORWINDOWS.COM.AU AND PUBLICATIONS FOR DOWNLOAD ARE GIVEN TO THE BEST OF OUR KNOWLEDGE AND IN GOOD FAITH. BUSHFIRE CONTROL IS NOT RESPONSIBLE IF RECIPIENTS OF TEST REPORTS, ASSESSMENTS OR LITERATURE MISINTERPRET THE CONTENTS AND WRONGLY USE PRODUCTS BASED ON THOSE MISINTERPRETATIONS. NO LIABILITY IS ACCEPTED FOR ERROR OMISSIONS IN THIS WEB SITE OR OUR DOCUMENTS. IN THE INTERESTS OF IMPROVEMENTS AND CONTINUED DEVELOPMENT BUSHFIRE CONTROL RESERVES THE RIGHT TO CHANGE SPECIFICATION WITHOUT NOTICE.

INFORMATION COPY ONLY

BUSHFIRE CONTROL | WARRIOR

WWW.BUSHFIRECONTROL.COM.AU

ABN 92 623 863 810
20 GEORGE YOUNG STREET
AUBURN, NSW 2144

EMAIL: INFO@BUSHFIRECONTROL.COM.AU
FREE CALL: 1800 218 258
FAX: (02) 9681 1600

PROJECT
SCS/BC - WS TEMP
BUSHFIRE CONTROL - WARRIOR FZ
MOTORISED SHUTTER TEMPLATE

CLIENT

TITLE
TYPICAL WIRE CONFIGURATION - 1

SUB SET (CATEGORY)
02 - WARRIOR FZ MOTORISED SHUTTERS

DRAWING NUMBER
SCS/BC - WS TEMP-0203

REV
B

DRAWN BY
ISHTIAQUE ALAM


ISSUE STATUS:
INFORMATION ONLY

START DATE
20/07/2020


SCALE
AS SHOWN @A2

FILE: Bushfire Control - Warrior FZ Shutter.dwg --- PLOTTED ON 30/06/2022 BY OZRA KHADEMI

<<< 420mm
<<< 594mm

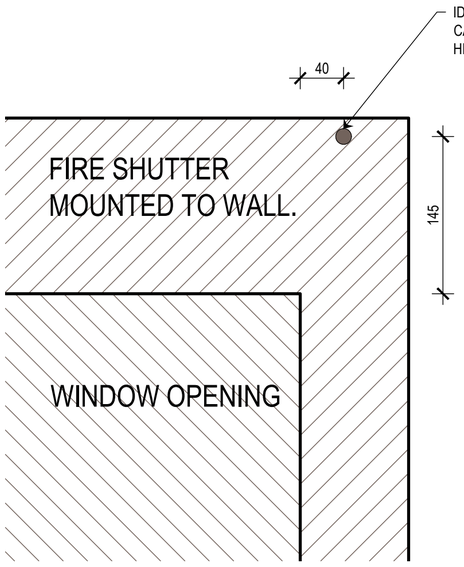

1 TYPICAL WIRING HOLE LOCATION (INDICATIVE ONLY)

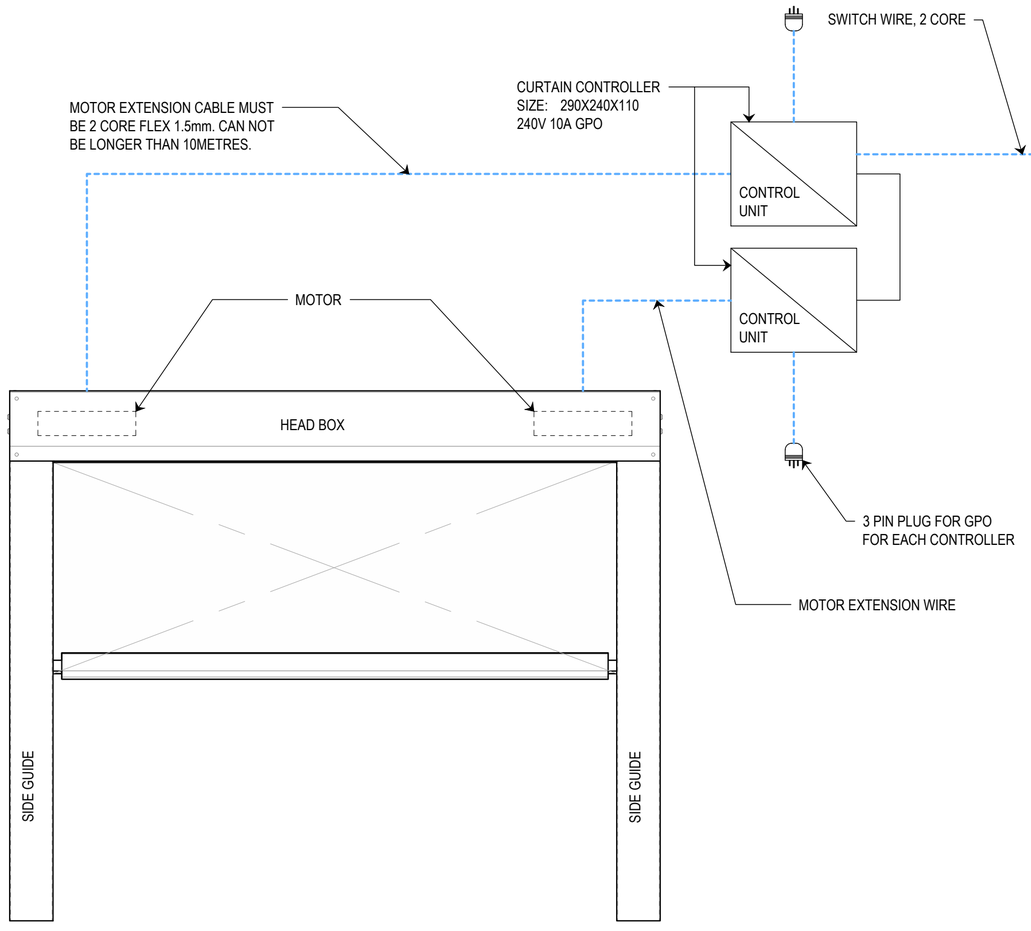

1 TYPICAL WIRE CONFIGURATION (INDICATIVE ONLY)

- THIS DRAWING IS COPYRIGHT AND THE PROPERTY OF THE AUTHOR, AND MUST NOT BE RETAINED, COPIED OR USED WITHOUT THE AUTHORITY OF BUSHFIRE CONTROL PTY. LTD.
- DO NOT SCALE FROM DRAWING, USE PROVIDED DIMENSIONS ONLY.
- ALL DISCREPENCIES MUST BE BROUGHT TO THE ATTENTION OF AUTHOR.
- SMOKE CONTROL SYSTEMS DO NOT TAKE RESPONSIBILITY OF MEASUREMENTS PROVIDED BY OTHERS.

REV	CHK	REASON	DATE
A	AC	RELEASED	27/08/2020

DISCLAIMER

INFORMATION GIVEN IN WARRIORWINDOWS.COM.AU AND PUBLICATIONS FOR DOWNLOAD ARE GIVEN TO THE BEST OF OUR KNOWLEDGE AND IN GOOD FAITH. BUSHFIRE CONTROL IS NOT RESPONSIBLE IF RECIPIENTS OF TEST REPORTS, ASSESSMENTS OR LITERATURE MISINTERPRET THE CONTENTS AND WRONGLY USE PRODUCTS BASED ON THOSE MISINTERPRETATIONS. NO LIABILITY IS ACCEPTED FOR ERROR OMISSIONS IN THIS WEB SITE OR OUR DOCUMENTS. IN THE INTERESTS OF IMPROVEMENTS AND CONTINUED DEVELOPMENT BUSHFIRE CONTROL RESERVES THE RIGHT TO CHANGE SPECIFICATION WITHOUT NOTICE.

INFORMATION COPY ONLY

BUSHFIRE CONTROL | WARRIOR

WWW.BUSHFIRECONTROL.COM.AU

ABN 92 623 863 810
20 GEORGE YOUNG STREET
AUBURN, NSW 2144

EMAIL: INFO@BUSHFIRECONTROL.COM.AU
FREE CALL: 1800 218 258
FAX: (02) 9681 1600

PROJECT
SCS/BC - WS TEMP
BUSHFIRE CONTROL - WARRIOR FZ
MOTORISED SHUTTER TEMPLATE

CLIENT


TITLE
TYPICAL WIRE CONFIGURATION - 2

SUB SET (CATEGORY)
02 - WARRIOR FZ MOTORISED SHUTTERS


DRAWING NUMBER	REV
SCS/BC - WS TEMP-0204	A

DRAWN BY	ISSUE STATUS:
ISHTIAQUE ALAM	INFORMATION ONLY
START DATE: 20/07/2020	SCALE: AS SHOWN @A2

FILE: Bushfire Control - Warrior FZ Shutter.dwg --- PLOTTED ON 30/06/2022 BY OZRA KHADEMI

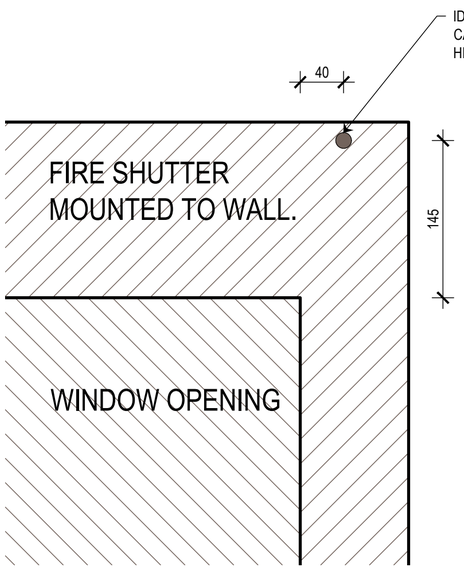

1 TYPICAL WIRING HOLE LOCATION (INDICATIVE ONLY)

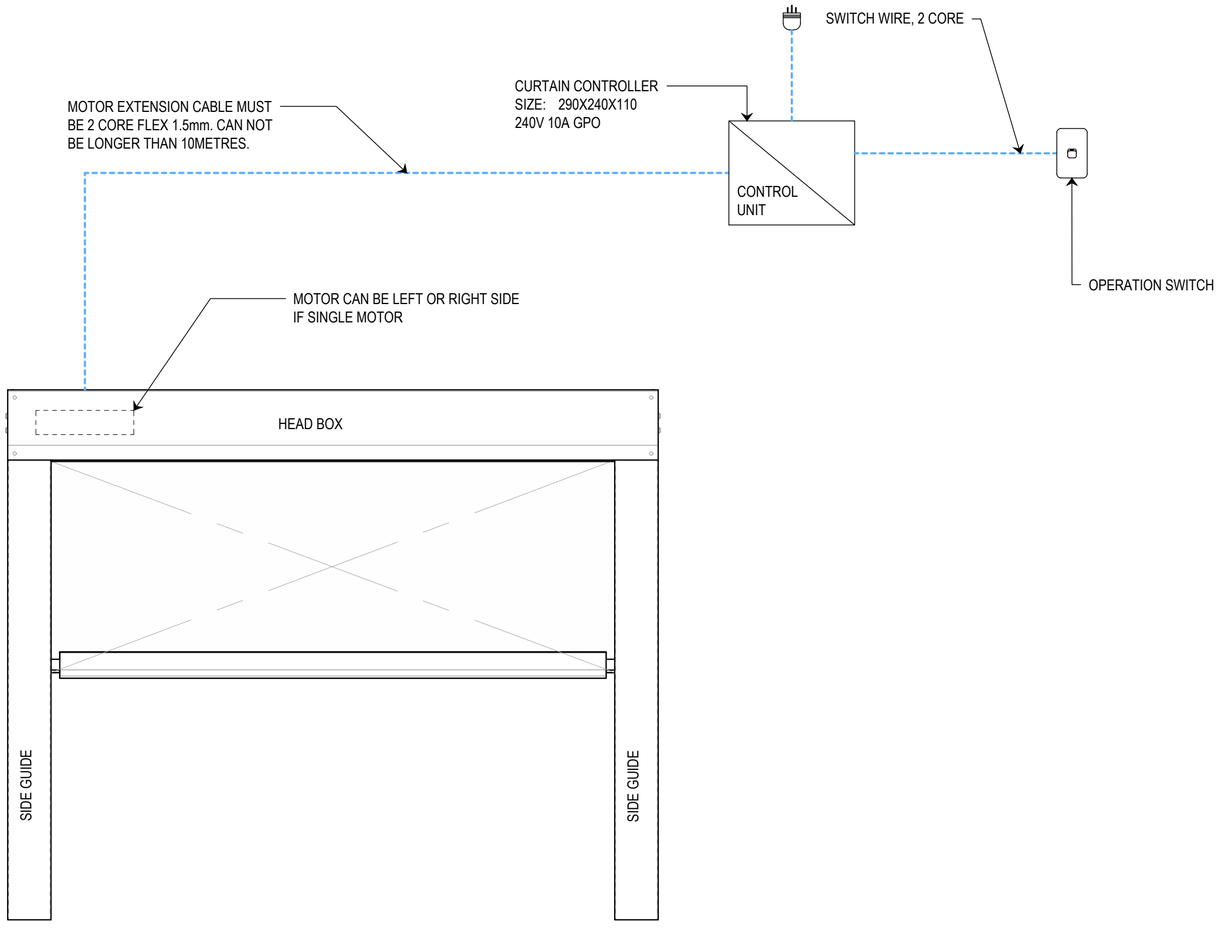

1 TYPICAL WIRE CONFIGURATION (INDICATIVE ONLY)

- THIS DRAWING IS COPYRIGHT AND THE PROPERTY OF THE AUTHOR, AND MUST NOT BE RETAINED, COPIED OR USED WITHOUT THE AUTHORITY OF BUSHFIRE CONTROL PTY. LTD.
- DO NOT SCALE FROM DRAWING, USE PROVIDED DIMENSIONS ONLY.
- ALL DISCREPENCIES MUST BE BROUGHT TO THE ATTENTION OF AUTHOR.
- SMOKE CONTROL SYSTEMS DO NOT TAKE RESPONSIBILITY OF MEASUREMENTS PROVIDED BY OTHERS.

REV	CHK	REASON	DATE
A	AC	RELEASED	27/08/2020

DISCLAIMER

INFORMATION GIVEN IN WARRIORWINDOWS.COM.AU AND PUBLICATIONS FOR DOWNLOAD ARE GIVEN TO THE BEST OF OUR KNOWLEDGE AND IN GOOD FAITH. BUSHFIRE CONTROL IS NOT RESPONSIBLE IF RECIPIENTS OF TEST REPORTS, ASSESSMENTS OR LITERATURE MISINTERPRET THE CONTENTS AND WRONGLY USE PRODUCTS BASED ON THOSE MISINTERPRETATIONS. NO LIABILITY IS ACCEPTED FOR ERROR OMISSIONS IN THIS WEB SITE OR OUR DOCUMENTS. IN THE INTERESTS OF IMPROVEMENTS AND CONTINUED DEVELOPMENT BUSHFIRE CONTROL RESERVES THE RIGHT TO CHANGE SPECIFICATION WITHOUT NOTICE.

INFORMATION COPY ONLY

BUSHFIRE CONTROL | WARRIOR

WWW.BUSHFIRECONTROL.COM.AU

ABN 92 623 863 810
20 GEORGE YOUNG STREET
AUBURN, NSW 2144

EMAIL: INFO@BUSHFIRECONTROL.COM.AU
FREE CALL: 1800 218 258
FAX: (02) 9681 1600

PROJECT
SCS/BC - WS TEMP
BUSHFIRE CONTROL - WARRIOR FZ
MOTORISED SHUTTER TEMPLATE

CLIENT

TITLE
TYPICAL WIRE CONFIGURATION - 3

SUB SET (CATEGORY)
02 - WARRIOR FZ MOTORISED SHUTTERS

DRAWING NUMBER	REV
SCS/BC - WS TEMP-0205	A

DRAWN BY	ISSUE STATUS:
ISHTIAQUE ALAM	INFORMATION ONLY
START DATE	SCALE
20/07/2020	AS SHOWN @A2

FILE: Bushfire Control - Warrior FZ Shutter.dwg --- PLOTTED ON 30/06/2022 BY OZRA KHADEMI

<<< 420mm
<<< 594mm